

Z Series Digital Temperature Controller
Micro Controller PXG Series



- **Auto manual operation with A/M key**
- **Universal process value input**
- **Motorized valve control**
 - Position feed back
 - Servo control
- **Smart ramp-soak**
 - Increasing from 8 steps to 16 steps
 - Guaranty soak
- **Password function**
- **Alarm Flicker function**

PXG

Fuji Electric Systems Co., Ltd.

200ms sampling cycle and $\pm 0.3\%$ FS

Model: PXG

input Universal process value input

- Resistance bulb Pt100, Thermocouple (J,K,R,B,S,T,N,PL-II)
- DC voltage (1-5V,0-5V, 0-10V,2-10V,0-100mV)

input Remote-SV input

DC voltage (1-5V,0-5V)



input Control-output (5types)

- Relay contact
- SSR/SSC drive
- DC0-20mA/DC4-20mA
- Motor-operated valve manipulating
- DC0-5V/1-5V/0-10V/2-10V

input Digital output (Max 5 points)

input Position feedback input

100ohms to 2.5k ohms

input Digital input (Max 5 points)

input Transmitter power supply (PXG9 only)

RS485 modbus communication function


communication speed: 19200bps

PC loader interface and software through RS-232C Communication

PID palette (for 8 combinations)

Smart Ramp-soak


1 Increasing from 8 steps to 16 steps

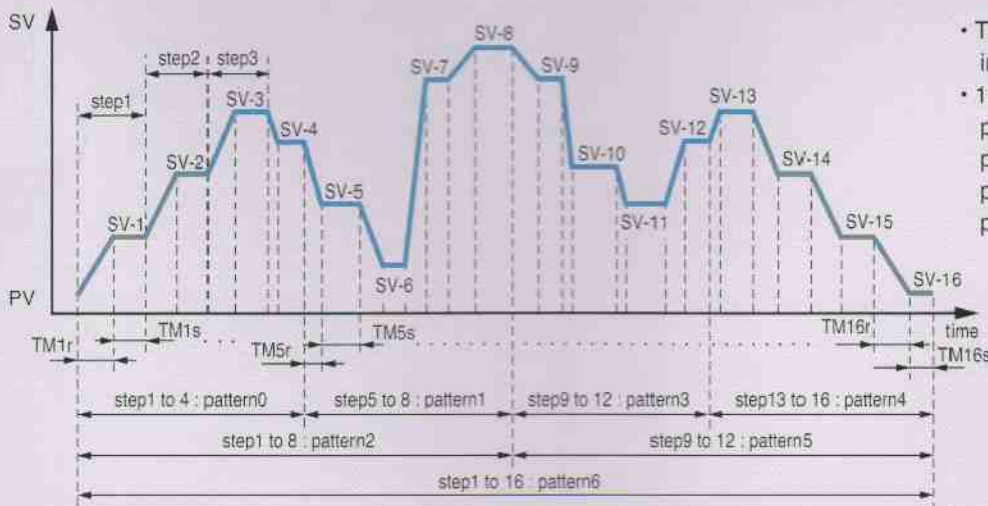

- The number of steps has been increased from 8 to 16.
- 16 steps can be used in 7 patterns.
 ptn0:step1 to 4, ptn1:step5 to 8,
 ptn2:step1 to 8, ptn3:step9 to 12
 ptn4:step13 to 16, ptn5:step9 to 16
 ptn6:step1 to 16

2 Guaranteed soak

This function guaranteed the soak time.
 Only soak time within the specified range of temperature for SV is counted towards soak time.

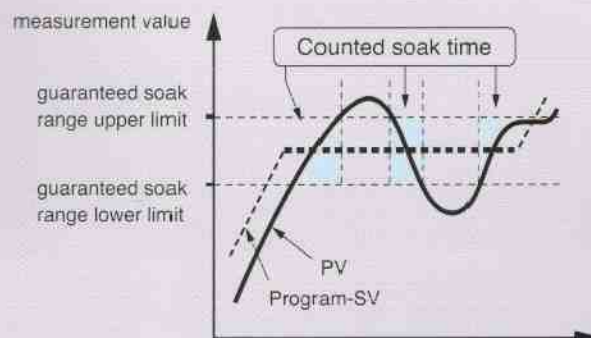


Specifications

General	Size and Mass	48x48x78.8mm, 0.2kg 48x96x80mm, 0.3kg 96x96x81.5mm, 0.3kg
	Power supply	AC100(-15%) - 240V(+10%), 50/60Hz AC 24V(±10%), DC24V(±10%), 50/60Hz
	Power consumption	12VA or Less
	External terminal	Screw terminal (M3)
Input	Measuring value input	Sampling cycle : 200ms (300ms at position feedback control) Input type : Universal input, thermocouple, resistance bulb mV, voltage, current
	Digital input	Number of input : Up to 5 points (up to 3 points for motor-operated valve manipulating output)
Function	Control method	PID control with 8 palette Motor-operated valve control with/without position feedback
	Control mode	Auto/Manual/Remote
	Alarm output	Up to 5 points
	Memory back-up	by non-volatile memory
Indication	Accuracy	±0.3%FS
	PV indicator	LED 7 segments 4 digit (Red color)
	SV indicator	LED 7 segments 4 digit (Green color)
	Indication status	6 indicator lamps
output	Control output	Up to 2 points (heating and cooling control if 2 points) 1. Relay contact output Contact structure : 1 NO (SPST) contact Contact rating : AC220V/DC30V, 3A (Resistive load) AC220V/DC30V, 1A (Inductive load) 2. SSR/SSC drive output DC20V (DC18-24V)/Max current 20mA Load resistance : 850ohms MIN 3. DC0-20mA/DC4-20mA output Accuracy : ±5% FS Linearity : ±5% FS Load resistance : 600ohms MAX 4. Voltage output DC0-5V/DC1-5V/DC0-10V/DC2-10V 5. Motor-operated valve manipulating output Contact structure : 2 NO (SPST) contacts Contact rating : AC220V/DC30V, 1A Mechanical life : 20 million operations MIN Electrical life : 100,000 operations MIN Output interlock/Output interlock circuit : Provided Except for PXG4
	Re-transmission output	Current output : (DC0-20mA, DC4-20mA) Voltage output : (DC0-5V/DC1-5V/DC0-10V/DC2-10V) Output type : PV, SV, MV, DV, PFB
	Digital output	Number of outputs : Max.5 points Contact structure : 1 NO (SPST) contact/Open collector Contact rating : AC220V/DC30V, 1A/DC30V, 100mA
	Transmitter power supply For PXG9	DC24V(DC19.5-24V) Max current : 21.6mA, 400ohms
	RS232C communication (Loader port interface)	Protocol
RS485 communication(Option)	Speed	9600bps
	Protocol	Modbus-RTU
Applied standards	Speed	9600bps, 19200bps
		UL, CE Mark

Application example

1 Re-Transmission Output


Averaging Temperature in Furnace

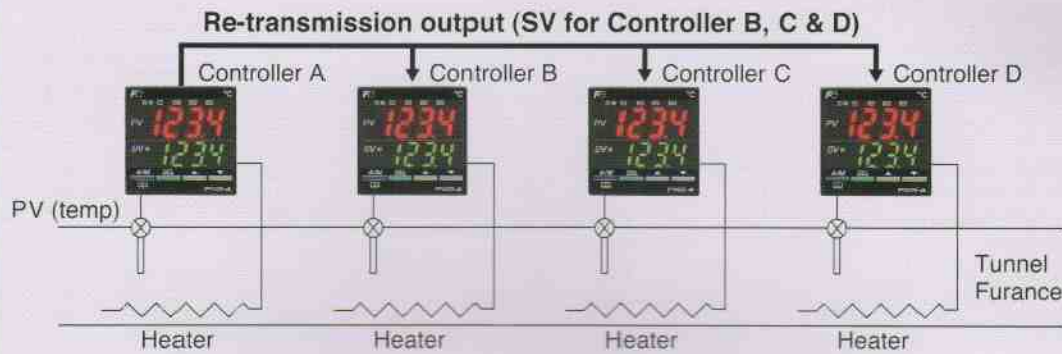

The PV of Controller A shall be treated as SV for other controller B, C & D so that the temperature in tunnel furnace can be equalized.

2 Soft Start Function


Plastic Extrusion Machine

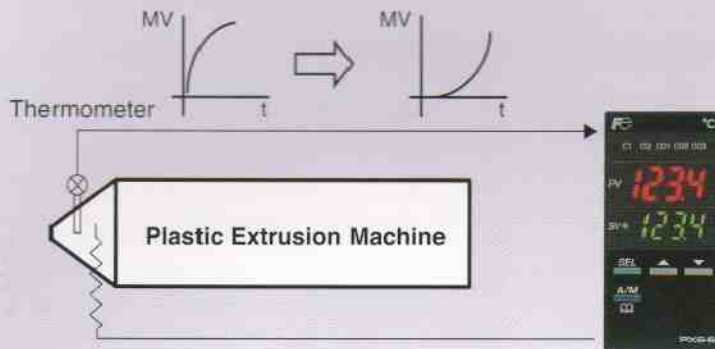

To protect nozzle material at turning on power of the machine, immediate heating the nozzle shall be with soft start function.

3 PID palette

PID Palette and SV select

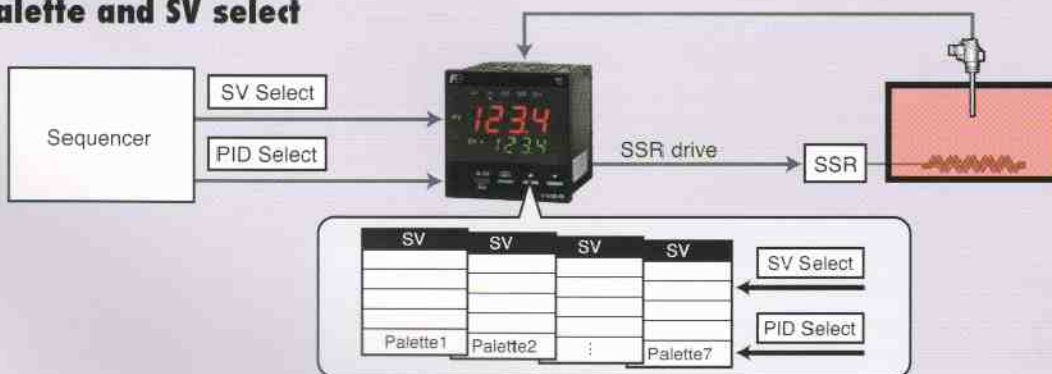


4 Servo control and PFB control

PXG is available for both Servo control and position feedback (PFB) control.

ex. Combustion control.

(Burner and Boiler)

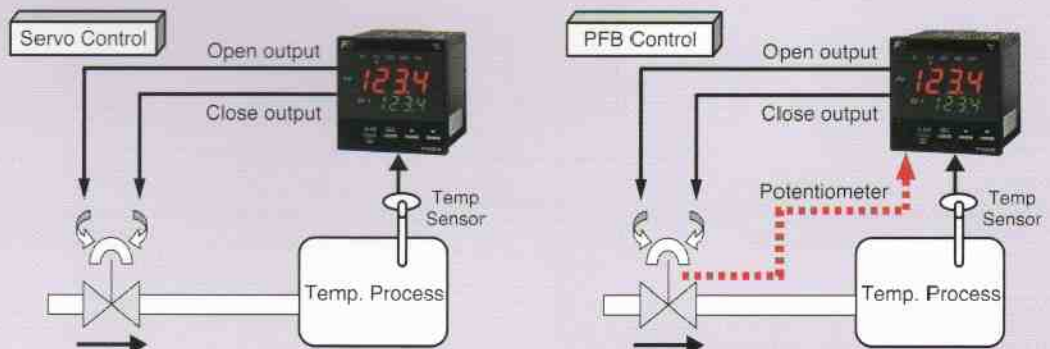

Ordering code

●PXG4 (Standard type)

Digit	Specifications	Note	PXG																				
			4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
4	<Front panel size W x H> 48 x 48mm		A	C	E	P																	
5	<Output 1> Relay contact SSR drive Current (0 to 20 mA DC/4 to 20 mA DC) Voltage (0 to 5 V DC/1 to 5 V DC/0 to 10 V DC/2 to 10 V DC)	Note1 Note1																					
6	<Output 2> None Relay contact SSR drive Current (0 to 20 mA DC/4 to 20 mA DC) Voltage (0 to 5 V DC/1 to 5 V DC/0 to 10 V DC/2 to 10 V DC) Re-transmission output, current (0 to 20 mA DC/4 to 20 mA DC) Re-transmission output, voltage (0 to 5 V DC/1 to 5 V DC/0 to 10 V DC/2 to 10 V DC)	Note2 Note4 Note2 Note4 Note2 Note4 Note2 Note4 Note2 Note4 Note2 Note4																					
7	<Option 1> None RS485 Digital input (No.1) + Digital input (No.2) Digital input (No.1) - RSV1 Digital input (No.1) - CT1 RS485 + Digital input (No.1) RS485 + RSV1 RS485 + CT1 RS485 + Digital input (No.1) + RSV1 Digital input (No.1) + RSV1 + Digital input (No.2)	Note1 Note3 Note1 Note3 Note1 Note3 Note1 Note3 Note1 Note3 Note1 Note3 Note1 Note3 Note1 Note3 Note1 Note3																					
8	<Revision symbol>																						
9	<Digital output> (relay contact output) None digital output 1 point (No.1) digital output 2 points (No.1,2) digital output 3 points (No.1,2,3) digital output 2 points (independent common) (No. 1, 2)	Note3 Note2																					
10	<Power source (instruction manual)> 100 to 240 V AC, no instruction manual 100 to 240 V AC, Japanese instruction manual 100 to 240 V AC, English instruction manual 24 V AC/DC, no instruction manual 24 V AC/DC, Japanese instruction manual 24 V AC/DC, English instruction manual																						
11	<Option 2>																						
12	None																						
13	None																						

- Note 1: If output 1 was for current or voltage output, option cannot be assigned to CT1. (If 7th digit was assigned to G or J, 5th digit cannot be assigned to E nor P.)
- Note 2: If output 2 was for relay contact, SSR drive, current, voltage or retransmission output, 3 digital outputs cannot be assigned. (If 6th digit was assigned to A, C, E, P, R or S, 9th digit cannot be assigned to M.)
- Note 3: If CT1 was selected in option 1, None in <Digital output> cannot be assigned. (If 7th digit was assigned to G or J, 9th digit cannot be assigned to 0.)
- Note 4: If RSV1 in option 1 and digital input 1 were selected simultaneously, output 2 cannot be assigned. (If 7th digit was assigned to F or 2, 6th digit cannot be assigned to A, C, E, P, R nor S.)

●PXG4 (Motor-operated valve control type)

Digit	Specifications	Note	PXG																				
			4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
4	<Front panel size W x H> 48 x 48mm		A																				
5	<Output 1> Motorized valve control output (Without PFB)	Note1																					
6	<Output 2> None																						
7	<Option 1> None Digital input (No.1) + RSV1 Digital input (No.1,2,3) RS485 + Digital input (No.1) RS485 + RSV1																						
8	<Revision symbol>																						
9	<Digital output> (relay contact output) None digital output 1 point (No.1) digital output 2 points (No.1,2) digital output 3 points (independent common) (No. 1, 2)																						
10	<Power source (instruction manual)> 100 to 240 V AC, no instruction manual 100 to 240 V AC, Japanese instruction manual 100 to 240 V AC, English instruction manual 24 V AC/DC, no instruction manual 24 V AC/DC, Japanese instruction manual 24 V AC/DC, English instruction manual																						
11	<Option 2>																						
12	None																						
13	None																						

- Note 1: If front panel size is 48 x 48, position feedback input (PFB input) function is not available.

●PXG5/PXG9 (Standard type)

Digit	Specifications	Note	PXG																				
			4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
4	<Front panel size W x H> 48 x 96mm 96 x 96mm		A	C	E	P																	
5	<Output 1> Relay contact SSR drive Current (0 to 20 mA DC/4 to 20 mA DC) Voltage (0 to 5 V DC/1 to 5 V DC/0 to 10 V DC/2 to 10 V DC)	Note1 Note1																					
6	<Output 2> None Relay contact SSR drive Current (0 to 20 mA DC/4 to 20 mA DC) Voltage (0 to 5 V DC/1 to 5 V DC/0 to 10 V DC/2 to 10 V DC) Re-transmission output, current (0 to 20 mA DC/4 to 20 mA DC) Re-transmission output, voltage (0 to 5 V DC/1 to 5 V DC/0 to 10 V DC/2 to 10 V DC) Transmitter power supply	Note1 Note1 Note3 Note3 Note3 Note3 Note3 Note3 Note3 Note3 Note3 Note3 Note6																					
7	<Option 1> None RS485 Digital input (No.1) + Digital input (No.2) Digital input (No.1) - RSV1 Digital input (No.1) - CT1 RS485 + Digital input (No.1) RS485 + RSV1 RS485 + CT1 RS485 + Digital input (No.1) + RSV1 Digital input (No.1) + RSV1 + Digital input (No.2)	Note2 Note1 Note4 Note5 Note1 Note4 Note5 Note2 Note4 Note5 Note2 Note4 Note5 Note2 Note4 Note5																					
8	<Revision symbol>																						
9	<Digital output> (relay contact output) None Digital output 1 point (No.1) Digital output 2 points (No.1,2) Digital output 3 points (No.1,2,3) Digital output 2 points (independent common) (No. 1, 2)	Note4																					
10	<Power source (instruction manual)> 100 to 240 V AC, no instruction manual 100 to 240 V AC, Japanese instruction manual 100 to 240 V AC, English instruction manual 24 V AC/DC, no instruction manual 24 V AC/DC, Japanese instruction manual 24 V AC/DC, English instruction manual																						
11	<Option 2> None Digital input (No.3,4,5) + CT2 Digital input (No.3,4,5) Digital input (No.3,4,5) + digital output (No.4,5) [transistor output] Digital input (No.3,4,5) + RSV2	Note1 Note4 Note5 Note2																					
12	None																						
13	None																						

- Note 1: If output 1 was for current or voltage output, option cannot be assigned to CT1 nor CT2. (If 7th digit was assigned to G or J or 11th digit to A, 5th digit cannot be assigned to E nor P.)
- Note 2: RSV1 in option 1 and RSV2 in option 2 cannot be assigned simultaneously. (If 7th digit was assigned to H or K, 11th digit cannot be assigned to D.)
- Note 3: In case, in option 1, of DI 2 points + RSV1 or RS485 + DI 1 + RSV1, output 2 cannot be assigned. (If 7th digit was assigned to F or 2, 6th digit cannot be assigned to A, C, E, P, R, nor S.)
- Note 4: In case of CT1 in option 1, or CT2 in option 2, digital output cannot be assigned to None. (If 7th digit was assigned to G or J, or 11th digit to A, 9th digit cannot be assigned to 0.)
- Note 5: CT1 in option 1 and CT2 in option 2 cannot be selected simultaneously. (If 7th digit was assigned to G or J, 11th digit cannot be assigned to A.)
- Note 6: Transmitter power supply is only for PXG9.

●PXG5/PXG9 (Motor-operated valve control type)

Digit	Specifications	Note	PXG																				
			4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
4	<Front panel size W x H> 48 x 96mm 96 x 96mm		A																				
5	<Output 1> Motorized valve control output (Without PFB) Motorized valve control output (With PFB)																						
6	<Output 2> None Auxiliary Digital output Transmitter power supply	Note1																					
7	<Option 1> None Digital input (No.1,2,3) + RSV1 RS485 + Digital input (No.1,2,3) RS485 + Digital input (No.1) + RSV1																						
8	<Revision symbol>																						
9	<Digital output> (relay contact output) None Digital output 1 point (No.1) Digital output 2 points (No.1,2) Digital output 3 points (independent common) (No. 1, 2)																						
10	<Power source (instruction manual)> 100 to 240 V AC, no instruction manual 100 to 240 V AC, Japanese instruction manual 100 to 240 V AC, English instruction manual 24 V AC/DC, no instruction manual 24 V AC/DC, Japanese instruction manual 24 V AC/DC, English instruction manual																						
11	<Option 2> None																						
12	None																						
13	None																						

- Note 1: Transmitter power supply is only PXG9.

Outline Diagram and Panel Cut (Unit:mm)

Model	Outline	Panel Cut
PXG4		
PXG5		
PXG9		

⚠ Precautions for use

To ensure temperature process safety in case of PXG's failure, fit a separate over-temperature protection unit to isolate the heating circuit. Uncontrollability due to such failure may cause major accident.

Fuji Electric Systems Co., Ltd.

Head Office
6-17, Sanbancho, Chiyoda-ku, Tokyo, 102-0075, Japan
<http://www.fesys.co.jp/eng>

Sales Div.
International Sales Dept.
No.1, Fuji-machi, Hino-city, Tokyo, 191-8502 Japan
Phone : 81-42-585-6201,6202
Fax : 81-42-585-6187
<http://www.fic-net.jp/eng>